


MAR 20 1966

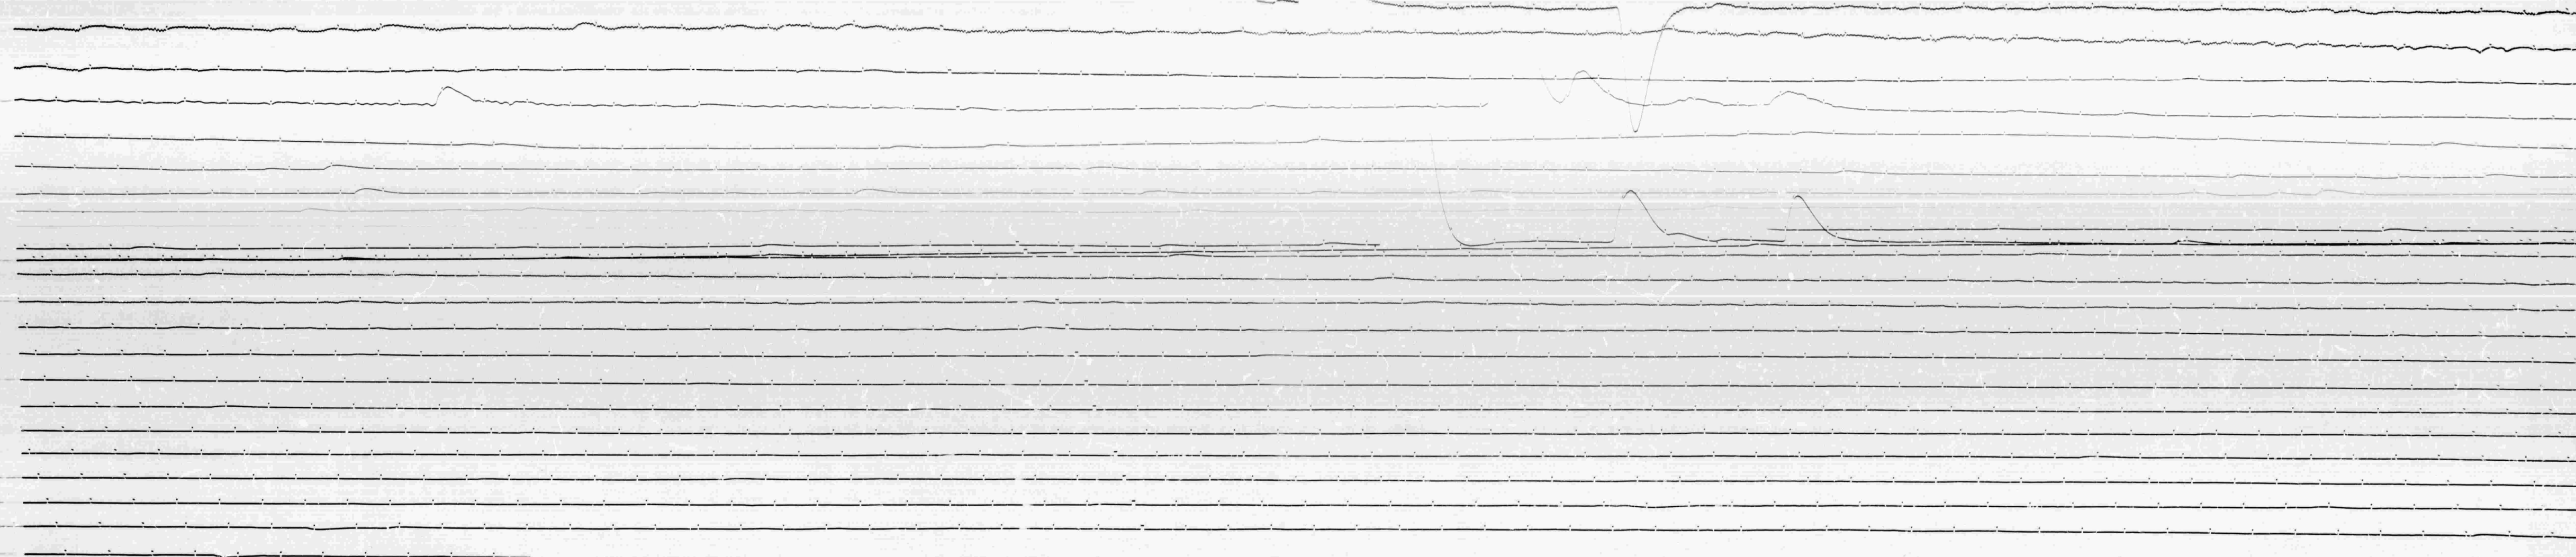

MAR 20 1966

500 2 500 to 0.40 0.10
 3-20-66 500 0 500
 3-20-66 225 0 225
 H 100 power out 0 225 up